


# Inside Tank



All flanges are SANS 1123: 1000\3 unless otherwise specified

5		Drawn:	BEW	Title: Typical Nozzle Installation	
4		Date:	2013 07 22	Dwg No:	Typical Nozzle Installation_R02
3		Approved:	BMcP	Rev:	02
2	BEW	2014 07 16	Liner representation added.	Description:	Standard
1	BEW	2014 02 18	Fasteners added	Sheet:	1 \ 1
Rev.	By	Date	Revisions		

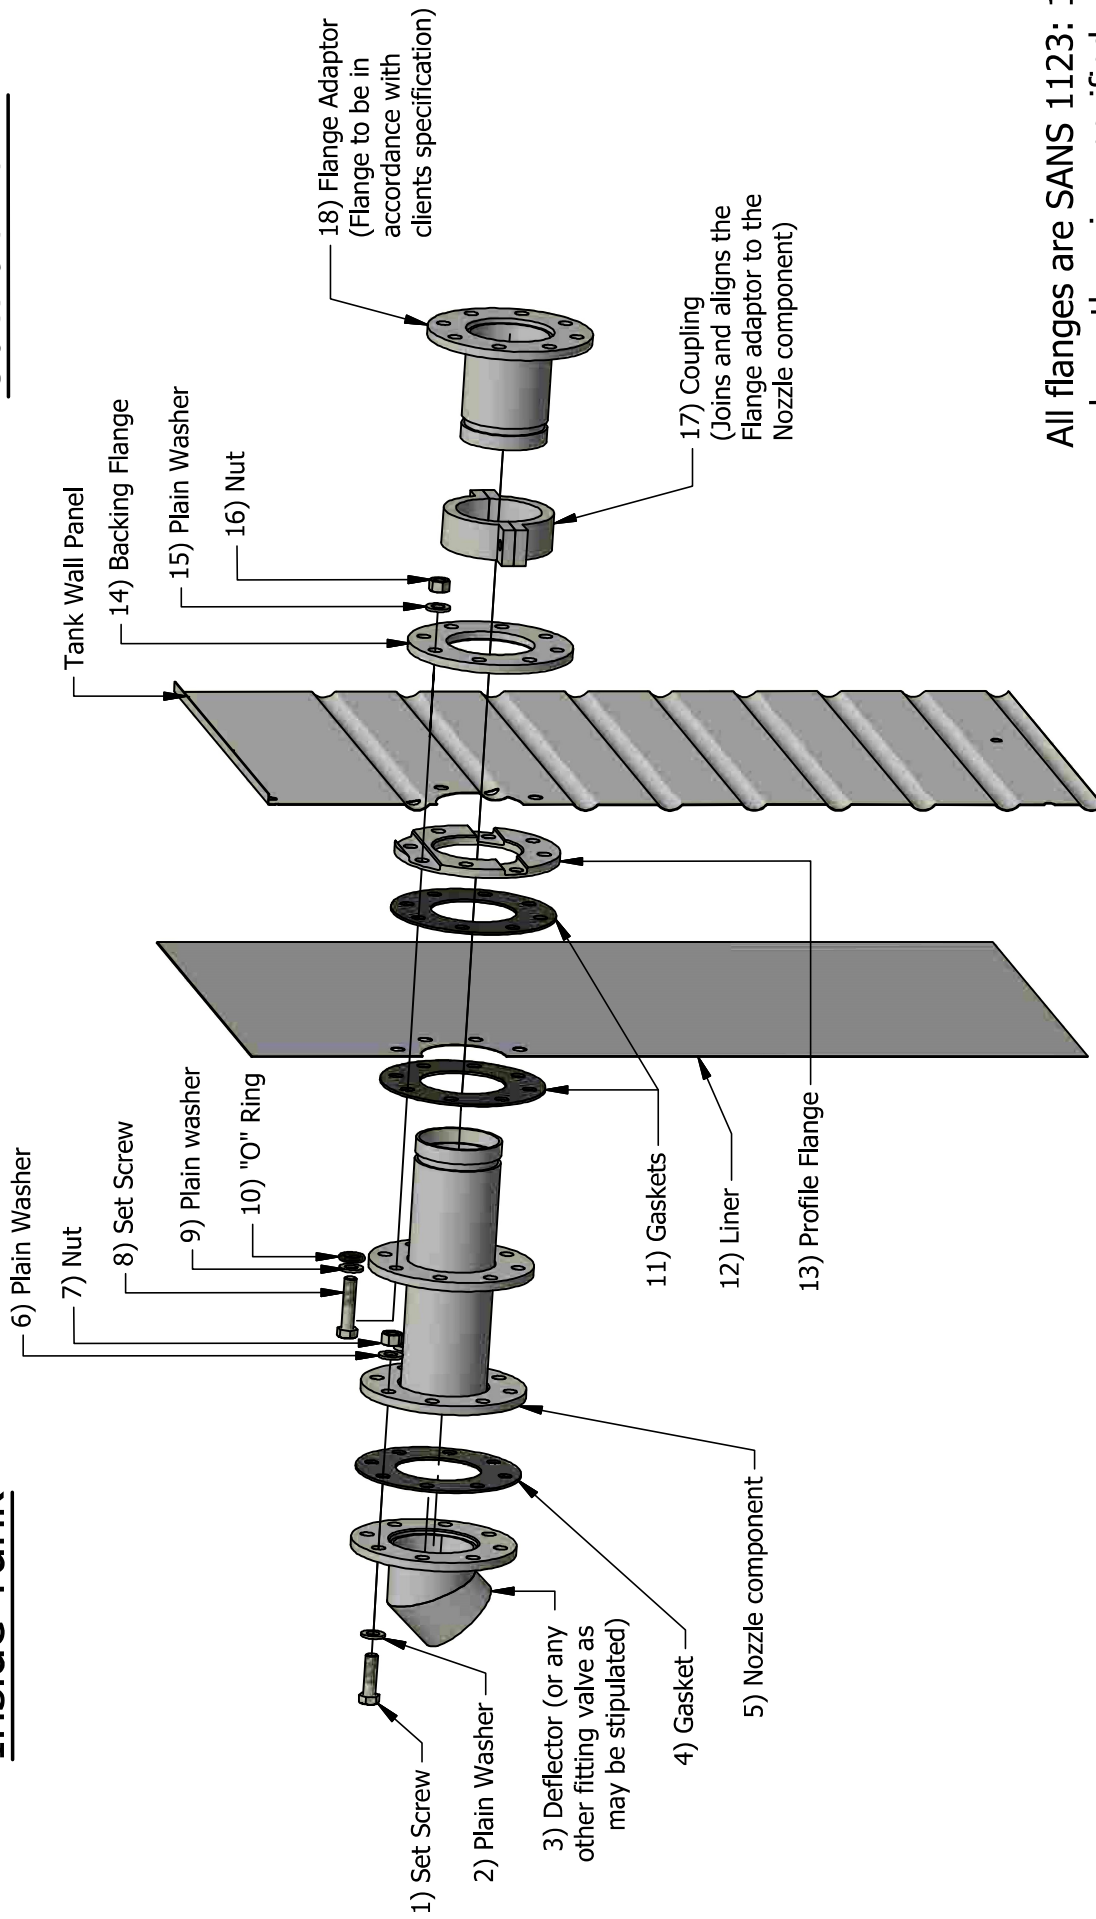